

Environmental Monitoring Report – Falconer Museum & Store

19th February 2026

05/11/2025 – 19/02/2026 data

*Note tiny tags calibrated October 2022

Handheld thermo-hygrometer weekly readings

<i>Museum Ground Floor (GF)</i>	4.5°C	52.3%
<i>Museum mezzanine</i>	4.5°C	57.1%

<i>Museum store GF</i>	17.1°C	55.0%
<i>Museum store 1st Floor</i>	16.5°C	56.3%


Data logger download data

Museum

No data from logger, probably forgot to relaunch, technical issue.

Museum data

<i>Museum</i>	Temp °C	Relative Humidity %
<i>Min</i>		
<i>Max</i>		
<i>Average</i>		

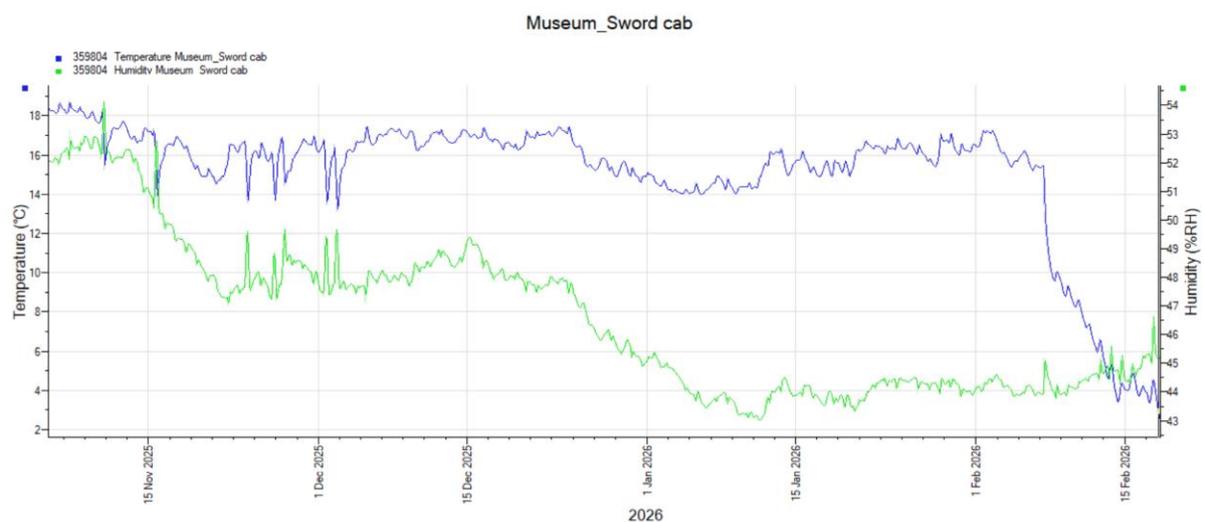

The graph shows the heating went off in the museum on the 7th February.


Museum Archaeological Cabinet	Temp °c	Relative Humidity %
Min	2.4°C	43.0%
Max	18.7°C	54.1%
Average	15.1°C	46.6%

Museum Store GF



Museum Store GF	Temp °c	Relative Humidity %
Min	13.5°C	47.6%
Max	16.6°C	63.7%
Average	14.9°C	54.1%

Museum Store 1st Floor

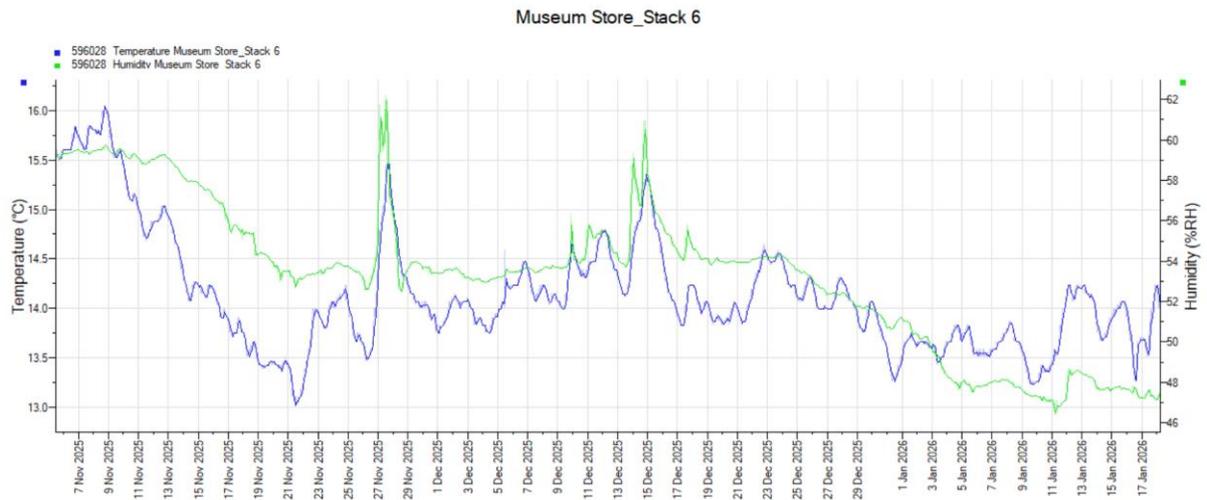

Battery ran out 18th Jan 00:00 – no notification it was running low in November

Museum Store 1st – stack 6	Temp °c	Relative Humidity %
Min	13.0°C	46.3%
Max	16.0°C	62.2%
Average	14.1°C	53.3%

All traps vacant of insects
Replaced all traps

Richard Aitken ACR
High Life Highland Conservation Service
High Life Highland & Registration Centre.