
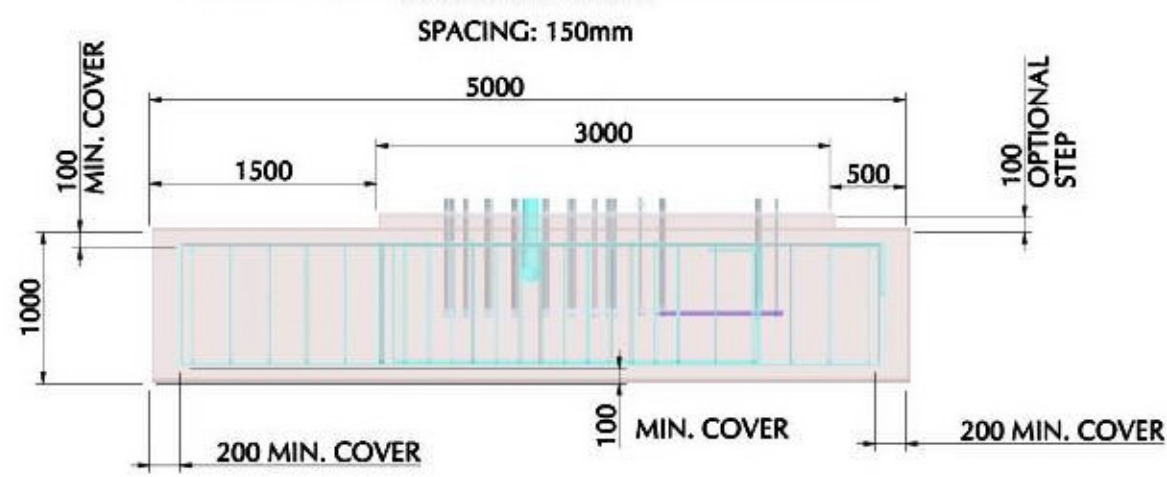
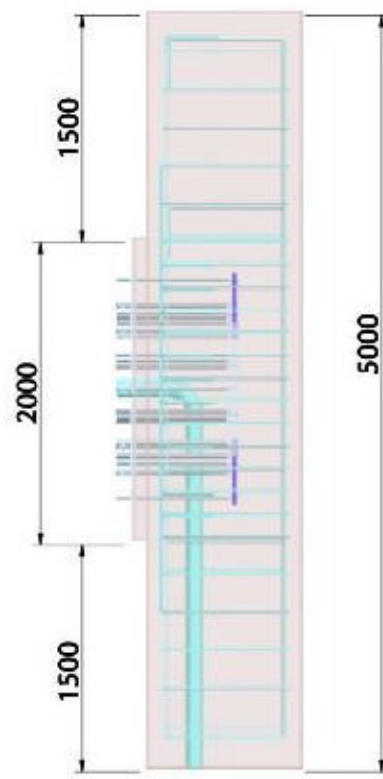


REV	NPI #	SUMMARY OF CHANGES	DATE	BY	CHK'D
A	-	INITIAL RELEASE	03-Aug-10	CO'N	-

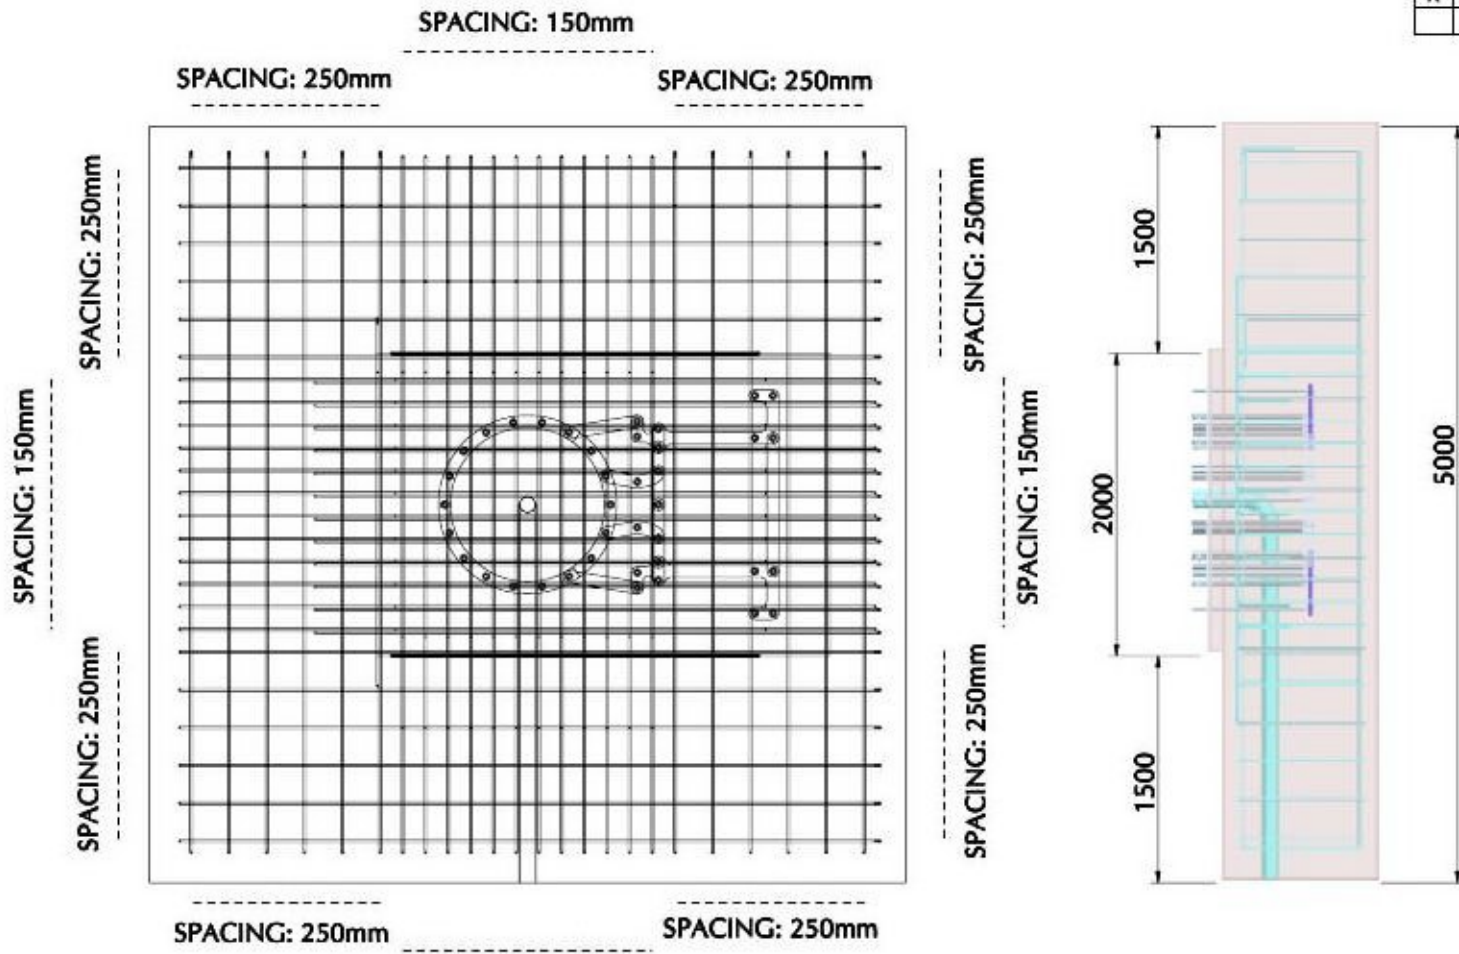


Town & Country Planning  
(Scotland) Act, 1997  
as amended

**REFUSED**

**01.07.2011**  
Development Management  
Environmental Services  
The Moray Council

1. FOUNDATION DESIGN BASED UPON ALLOWABLE NET SOIL BEARING PRESSURE OF MIN. 100kN/sq.m
2. MINIMUM COVER TO BE 100mm.
3. CONCRETE TO BE C35 TO BS8110 USING OPC AND 20mm MAX. AGGREGATE SIZE.
4. MAX. FREE WATER/CEMENT RATIO 0.55.
5. MINIMUM CEMENT CONTENT OF 325 Kg/m.
6. MONOPOLE BASEPLATE, TEMPLATES, DUCTING AND BOLTING ARRANGEMENT DETAILED SEPARATELY.
7. DUCTING TO BE A MAXIMUM OF 110mm DIAMETER
8. FOUNDATION SIZES FOR 20kW TURBINE: 5.0x5.0x1.0m (25 CU. METRES) [CLASS 1]

<b>C&amp;F Green-Energy</b> 		PART NUMBER: <b>A-0920</b>	
DESCRIPTION: <b>5.0 SQ. FOUNDATION</b>		QTY PER UNIT: 1	SCALE: -
MATERIAL: -	DRAWN: C O'Neill	PAINT: -	DWG SIZE: A4
CHECKED: -	DATE: 03-Aug-10	FINISH: -	SHEET: 1 OF 1